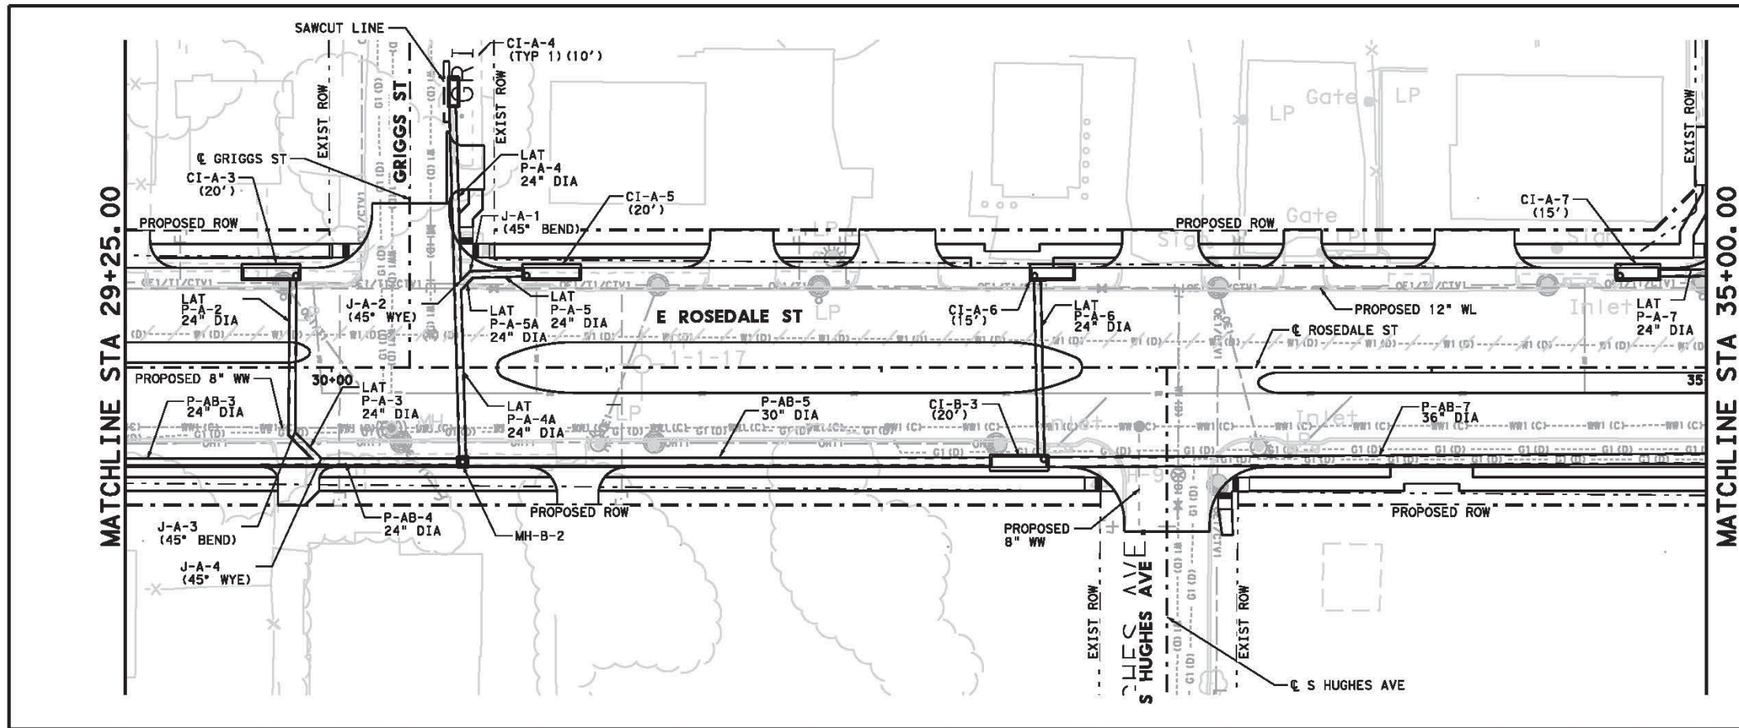

NOTES:

1. EXISTING STORM SEWER TO BE REMOVED UNLESS OTHERWISE NOTED.
2. ALL CURB INLETS ARE (TYP 2) UNLESS OTHERWISE NOTED.
3. ALL CURB INLETS SHALL HAVE RING AND COVER.
4. ALL PIPES ARE CLASS III REINFORCED CONCRETE PIPES UNLESS OTHERWISE NOTED.
5. ALL MANHOLES ARE TYP-1 UNLESS OTHERWISE NOTED.
6. ALL JUNCTION BOXES ARE TYP-1.
7. REFER TO WATER & SEWER REPLACEMENTS (CITY OF FORT WORTH PROJECT 01895) FOR ADDITIONAL INFORMATION ON EXISTING AND PROPOSED WATER/SEWER FACILITIES ALONG PROJECT LIMITS.
8. REFER TO INLET SUMMARY SHEET FOR STATION/OFFSET INFORMATION NOT SHOWN ON THIS SHEET.
9. REFER TO DRAINAGE LATERAL PROFILE SHEETS FOR STORM SEWER LATERALS.
10. SAWCUT AND REPAIR OF CURB AT LOCATIONS SHOWN WILL BE SUBSIDIARY TO COST OF INLET.

0 25 50 (H)
0 SCALE IN FEET 10 (V)

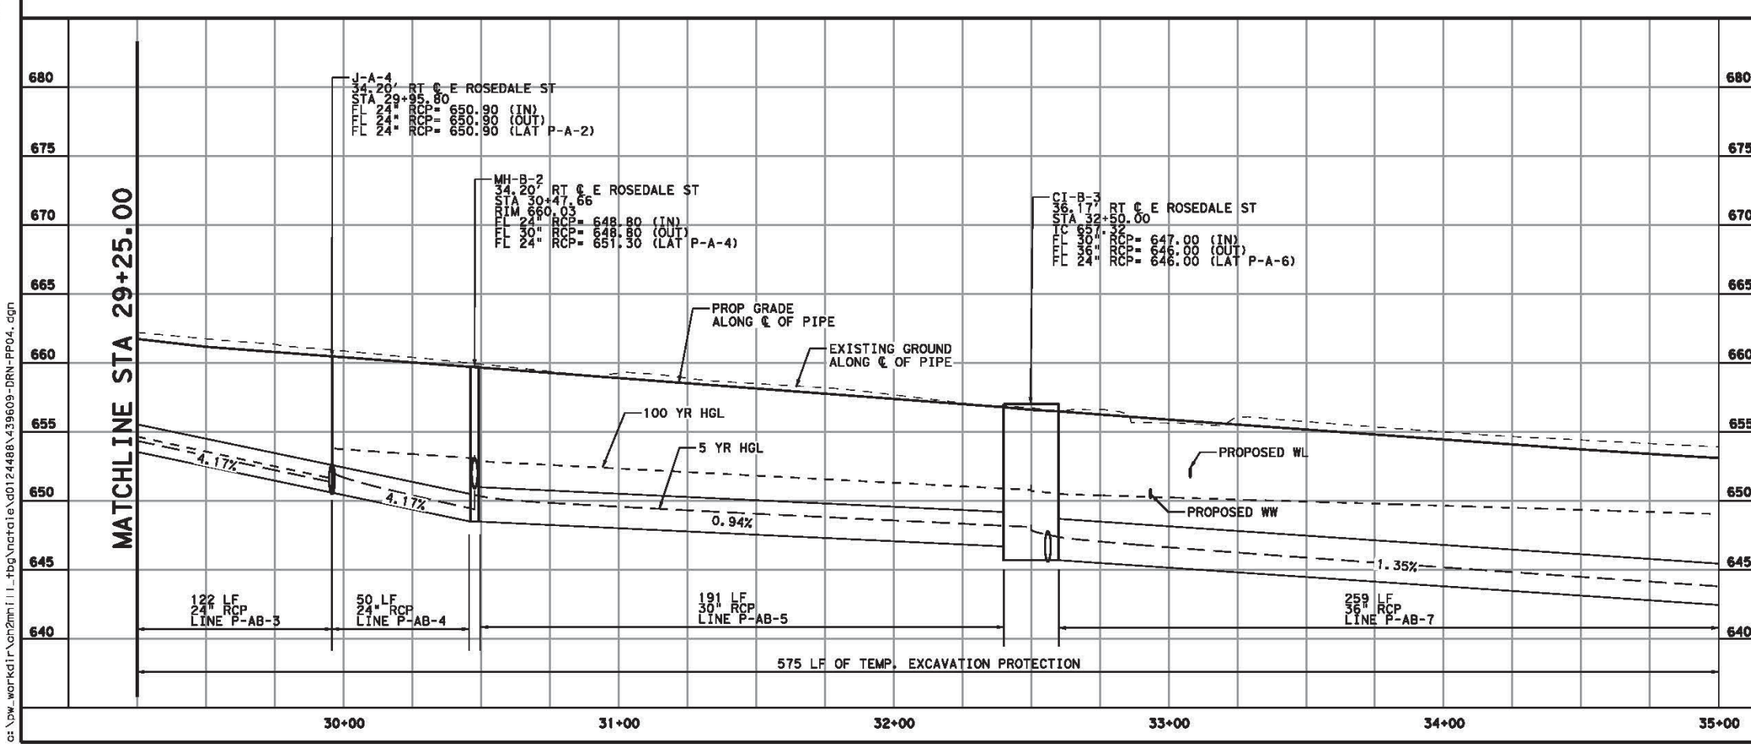

STATE OF TEXAS
PE NAME
XXXXX
LICENSED
PROFESSIONAL ENGINEER

Signature Date

NO.	DATE	REVISION	APPROV.

Texas Department of Transportation
© 2014 TxDOT

E ROSEDALE SP 303
DRAINAGE PLAN & PROFILE
STA 29+25 - STA 35+00

SHEET 4 OF 25

FED. RD. DIV. NO.	PROJECT NO.	SHEET NO.
6	SEE TITLE SHEET	395

STATE	DIST.	COUNTY
TEXAS	FTW	TARRANT

CONT.	SECT.	JOB	HIGHWAY NO.
			SP 303

12/8/2014 10:28:02 AM c:\pw_workdir\ah2mill_tbg\nctale\d0124488\439609-DRN-PP04.dgn
$USER$